


Ship's LP Air System

Typical USN Ship's Low-Pressure Air System, Schematic

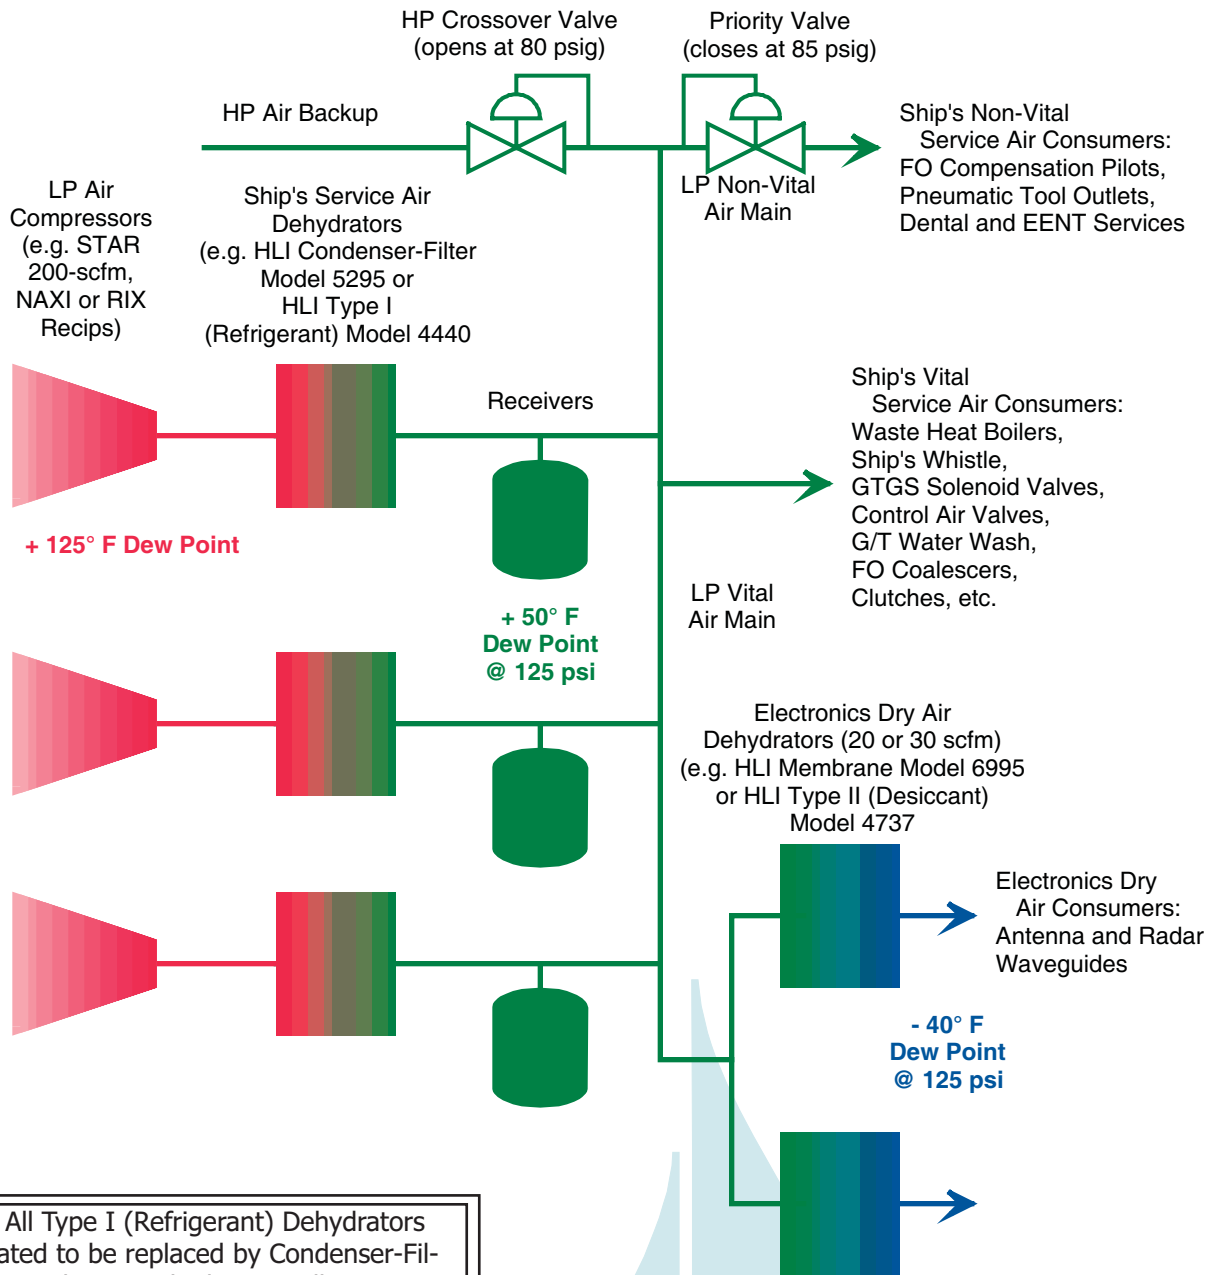

Note: All Type I (Refrigerant) Dehydrators are slated to be replaced by Condenser-Filter or Membrane Dehydrators. All Type II (Desiccant) Dehydrators are to be replaced by Membrane Dehydrators.

Howell Laboratories, Inc.

188 Harrison Rd.
Bridgton, Maine 04009
(207) 647-3327

(888) 744-8359

FAX (207) 647-8273

e-mail: contracts@howelllabs.com
An Employee-Owned Company

web: www.howelllabs.com
Certified to ISO 9001:2000