


Ship's LP Air System

Typical USN Ship's Low-Pressure Air System, Schematic

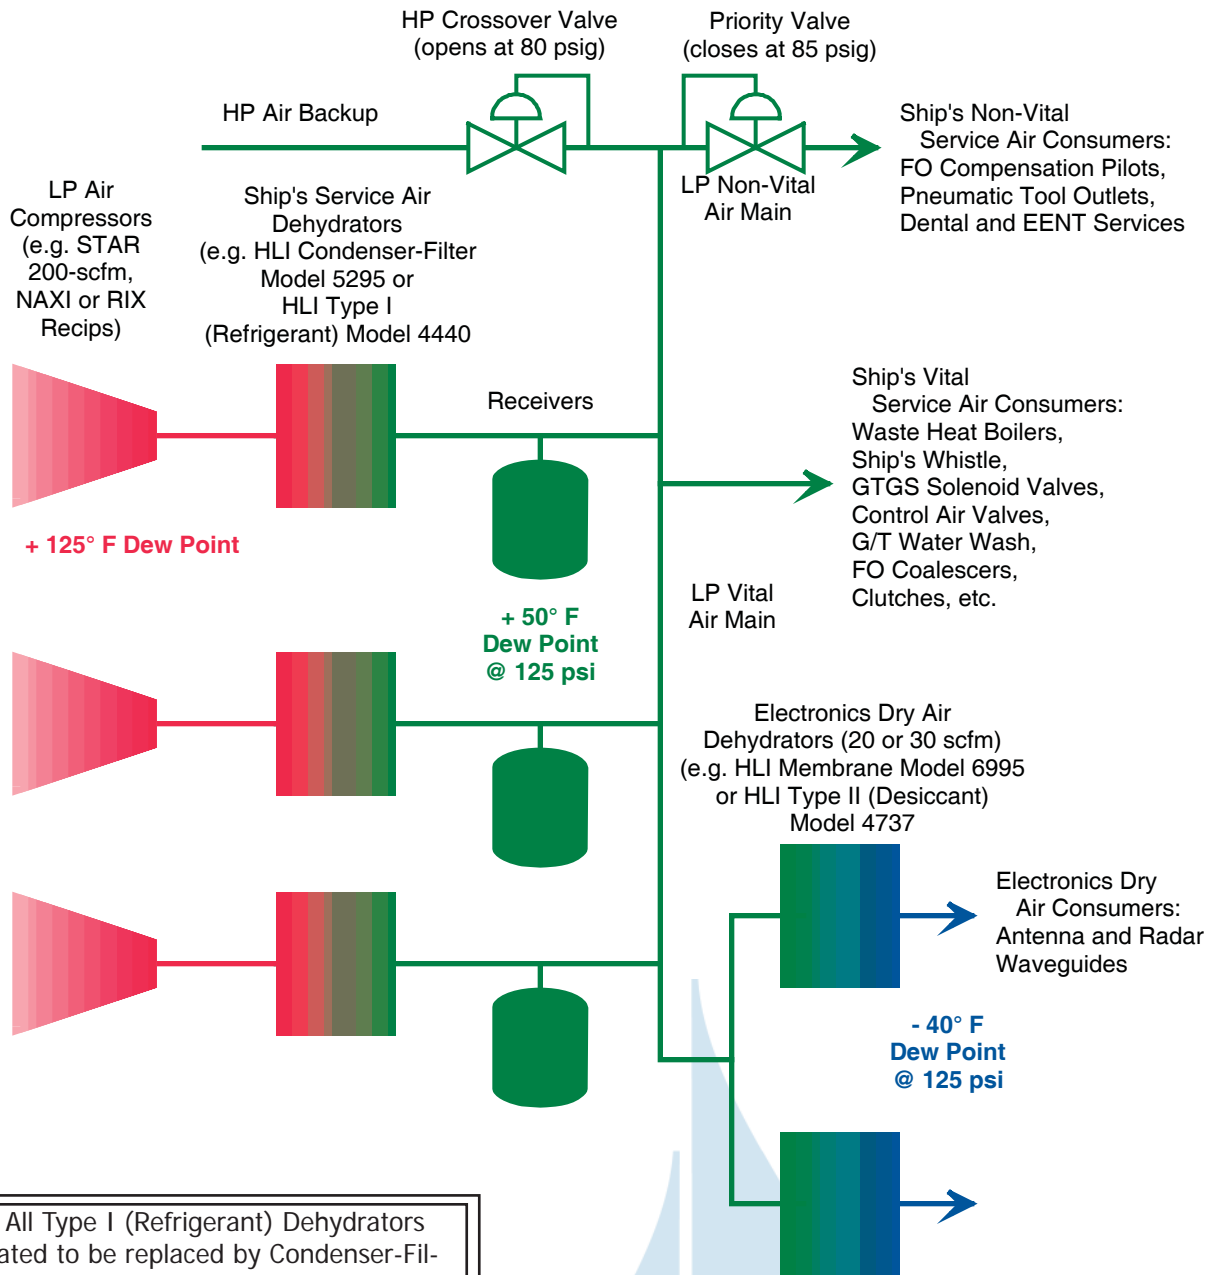

Note: All Type I (Refrigerant) Dehydrators are slated to be replaced by Condenser-Filter or Membrane Dehydrators. All Type II (Desiccant) Dehydrators are to be replaced by Membrane Dehydrators.

Howell Laboratories, Inc.

188 Harrison Rd.
Bridgton, Maine 04009
(207) 647-3327

(888) 744-8359

FAX (207) 647-8273

Pub. No.: TB-Ship's LP Air System (110716)

e-mail: contracts@howelllabs.com

web: www.howelllabs.com

© 2001-2011 Howell Laboratories, Inc. All rights reserved.

An Employee-Owned Company

Certified to ISO 9001